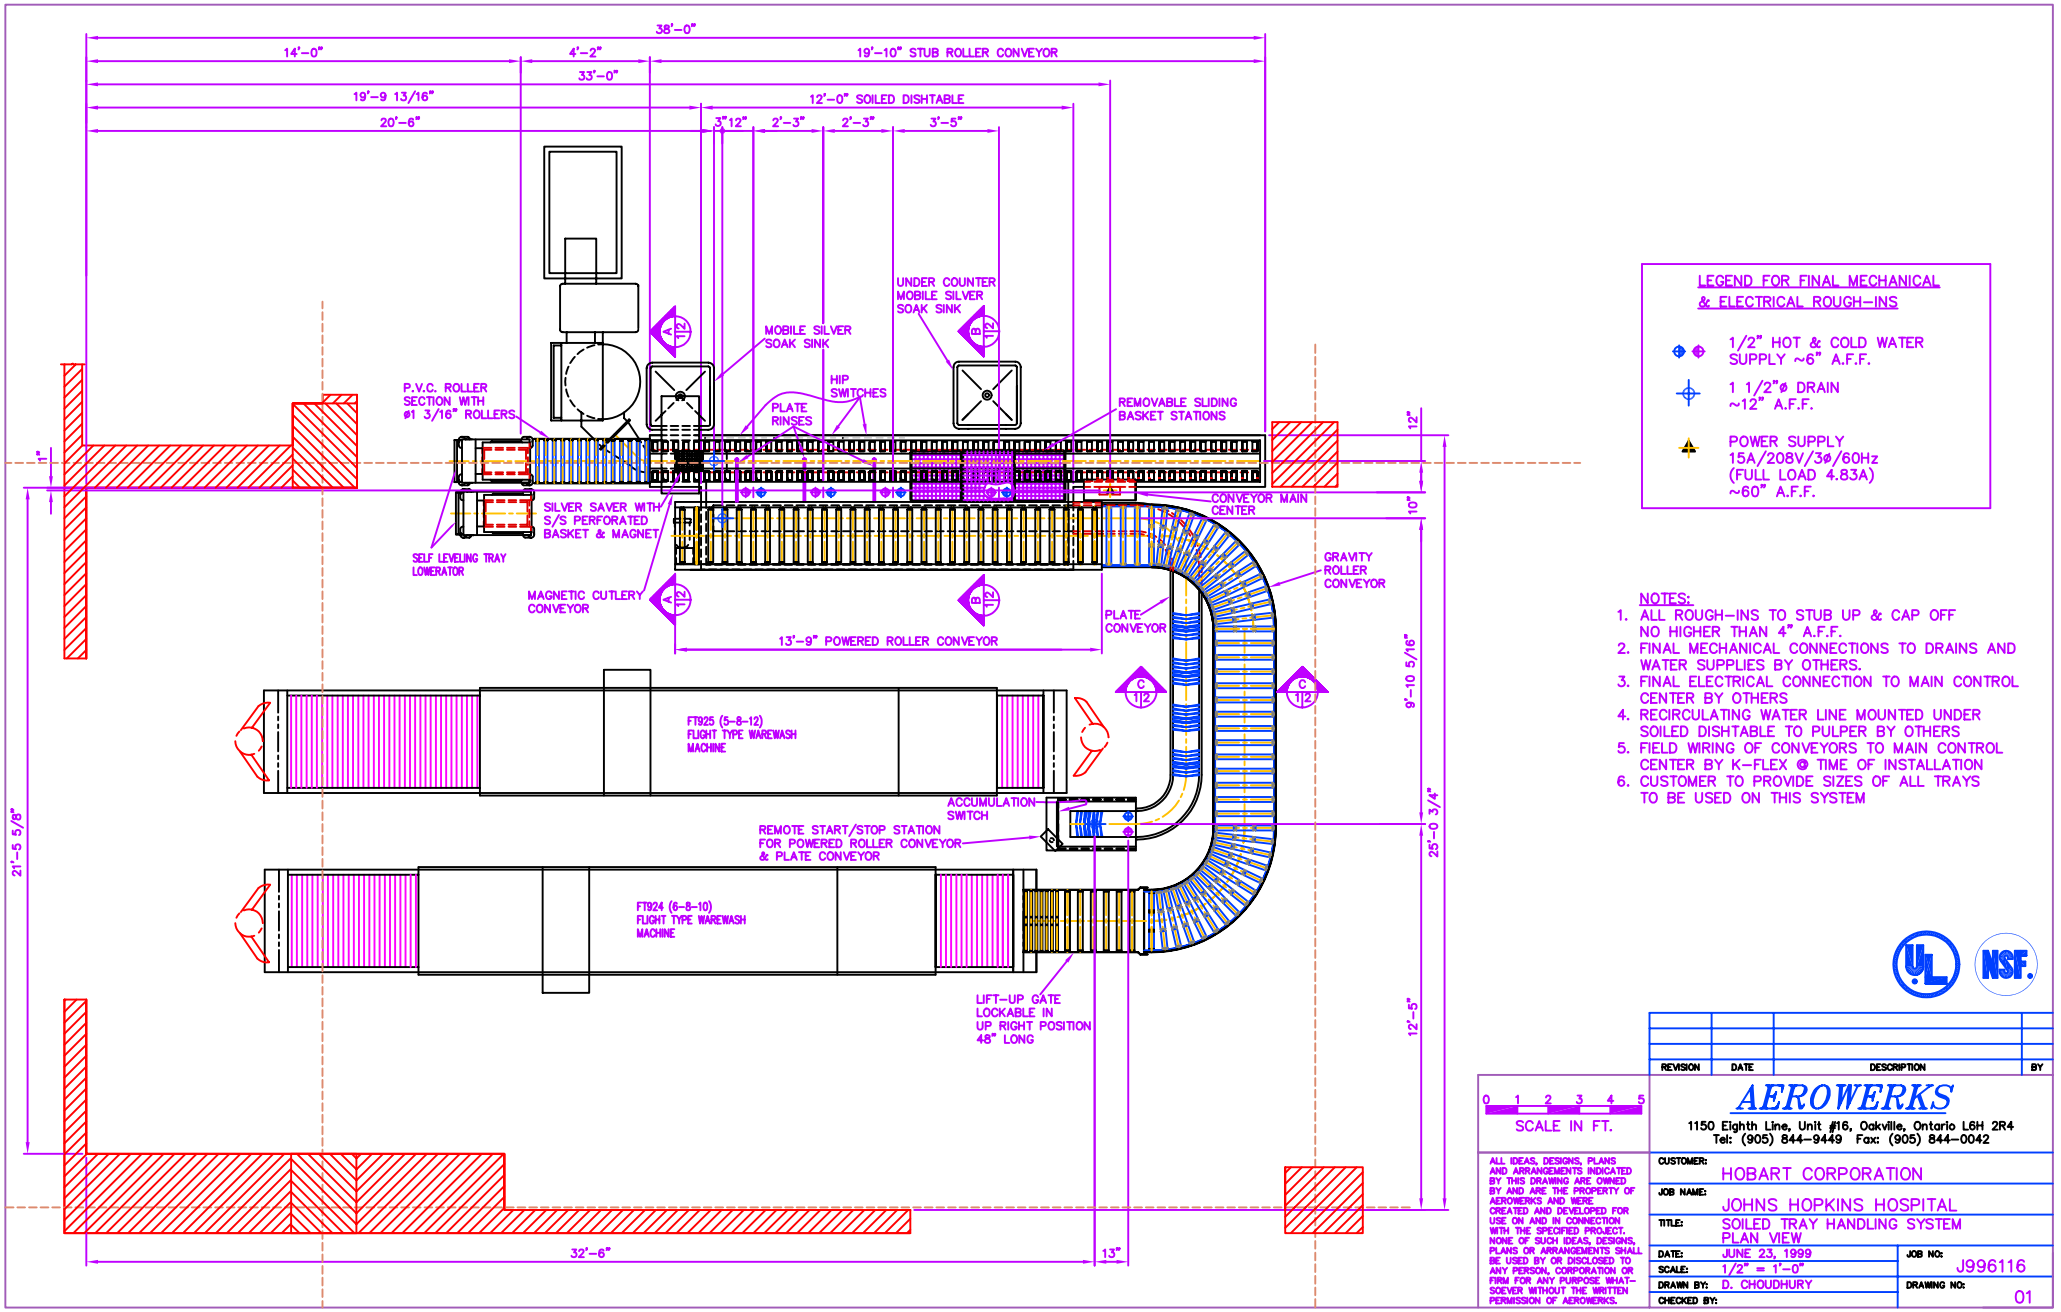

LEGEND FOR FINAL MECHANICAL & ELECTRICAL ROUGH-INS

- 1/2" HOT & COLD WATER SUPPLY ~6" A.F.F.
- 1 1/2"ø DRAIN ~12" A.F.F.
- POWER SUPPLY 15A/208V/3ø/60Hz (FULL LOAD 4.83A) ~60" A.F.F.

NOTES:

1. ALL ROUGH-INS TO STUB UP & CAP OFF NO HIGHER THAN 4" A.F.F.
2. FINAL MECHANICAL CONNECTIONS TO DRAINS AND WATER SUPPLIES BY OTHERS.
3. FINAL ELECTRICAL CONNECTION TO MAIN CONTROL CENTER BY OTHERS
4. RECIRCULATING WATER LINE MOUNTED UNDER SOILED DISHTABLE TO PULPER BY OTHERS
5. FIELD WIRING OF CONVEYORS TO MAIN CONTROL CENTER BY K-FLEX @ TIME OF INSTALLATION
6. CUSTOMER TO PROVIDE SIZES OF ALL TRAYS TO BE USED ON THIS SYSTEM

REVISION	DATE	DESCRIPTION	BY

0 1 2 3 4 5
SCALE IN FT.

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

AEROWERKS
1150 Eighth Line, Unit #16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

CUSTOMER:	HOBART CORPORATION
JOB NAME:	JOHNS HOPKINS HOSPITAL
TITLE:	SOILED TRAY HANDLING SYSTEM PLAN VIEW
DATE:	JUNE 23, 1999
SCALE:	1/2" = 1'-0"
DRAWN BY:	D. CHOUDHURY
CHECKED BY:	
JOB NO:	J996116
DRAWING NO:	01

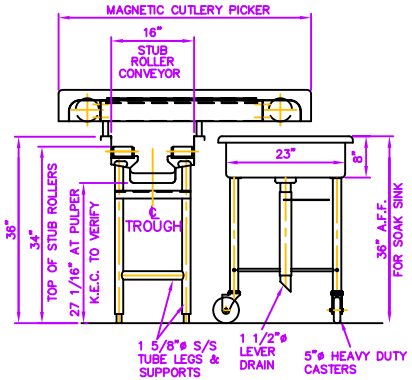

SECTION A 1/2

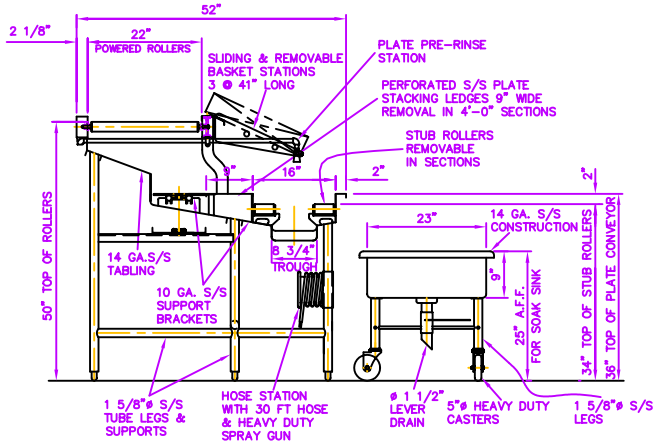

SECTION B 1/2

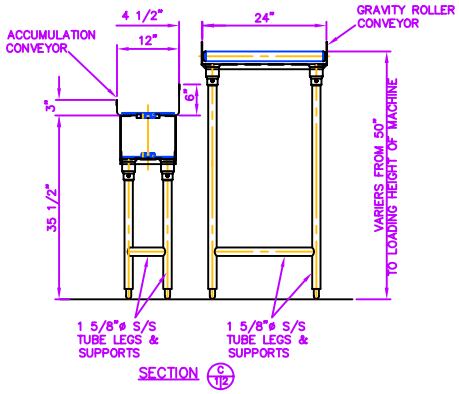

SECTION C 1/2

REVISION	DATE	DESCRIPTION	BY

0 6 12 18 24 30
SCALE IN INCHES

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

AEROWERKS
1150 Eighth Line, Unit #16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

CUSTOMER:	HOBART CORPORATION
JOB NAME:	JOHNS HOPKINS HOSPITAL
TITLE:	SOILED TRAY HANDLING SYSTEM CROSS SECTIONS
DATE:	JUNE 23, 1999
SCALE:	1" = 1'-0"
DRAWN BY:	D. CHOUDHURY
CHECKED BY:	
JOB NO:	J996116
DRAWING NO:	02

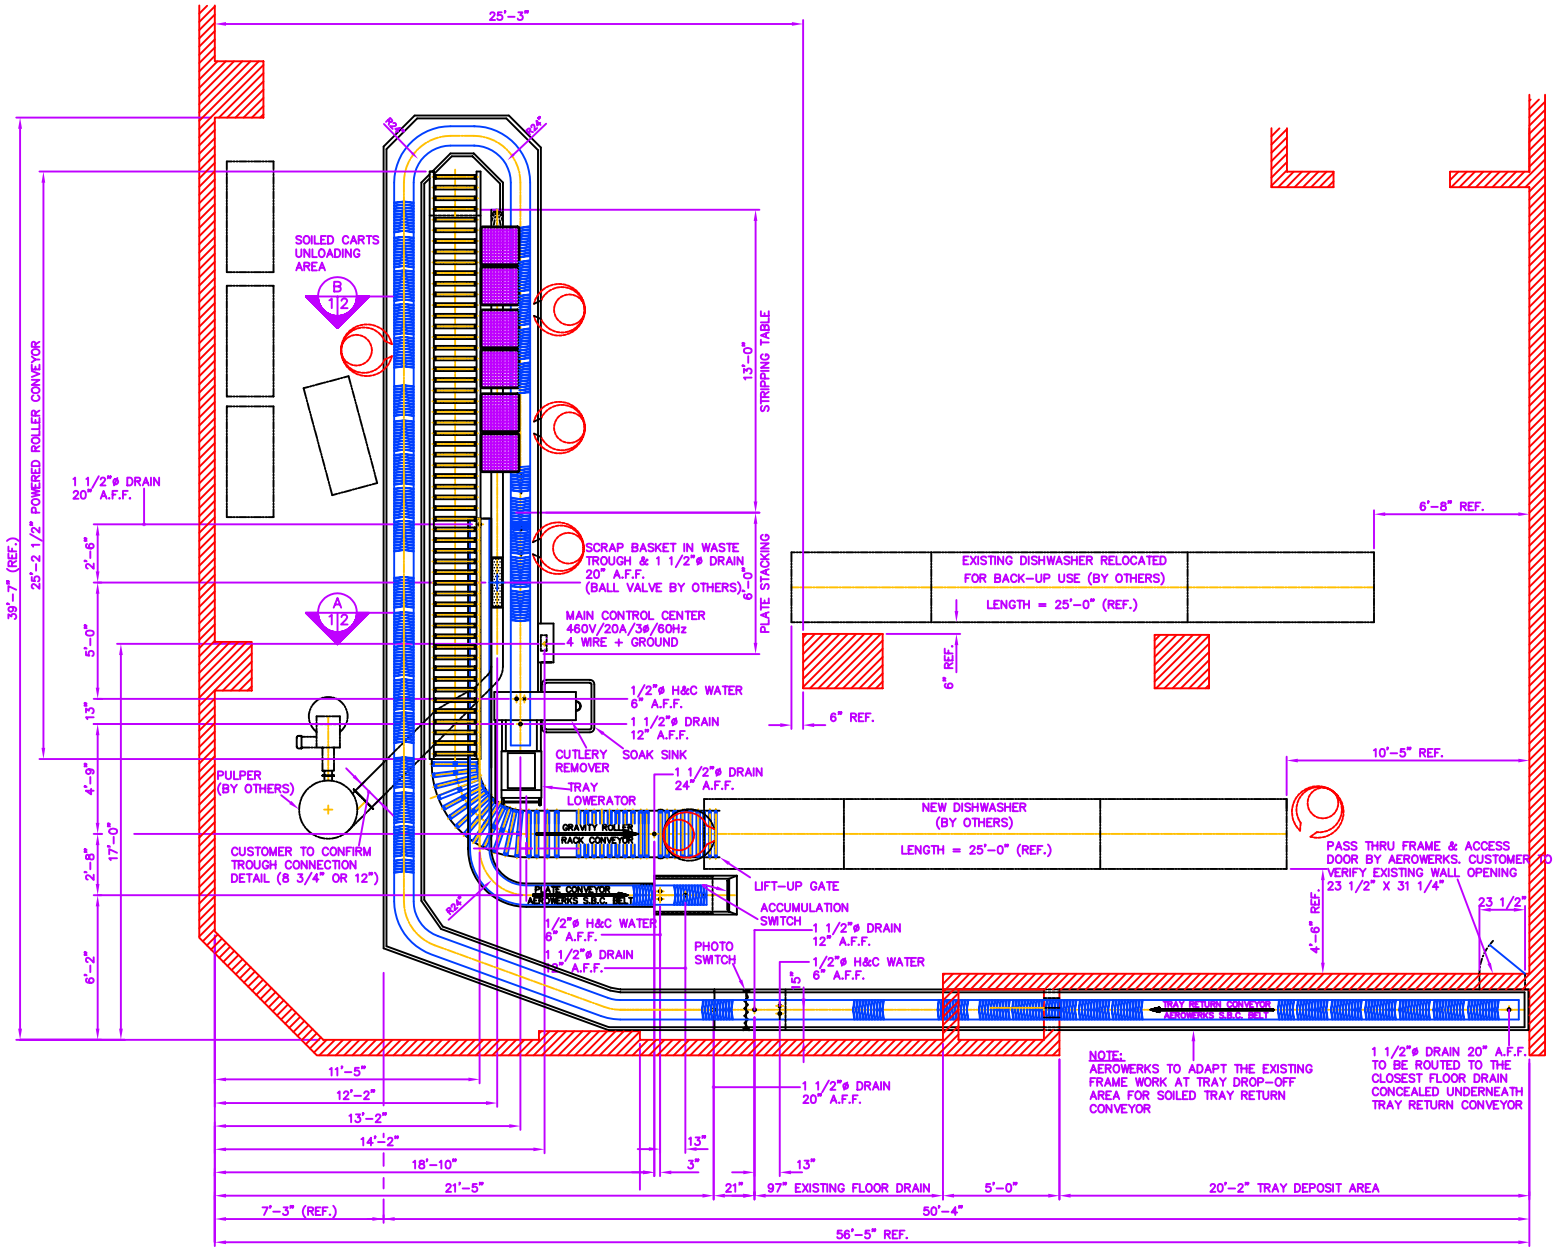

NOTES:
1. INTERWIRING BETWEEN CONTROL PANEL TO DRIVE CABINET BY AEROWERKS
2. EXTERNAL WIRING FROM POWER SOURCE TO CONTROL PANEL BY CUSTOMER
3. ALL ROUGH-INS STUB UP & CAP OFF NO HIGHER 4" ABOVE FINISHED FLOOR
4. CUSTOMER IS TO PROVIDE SIZES OF ALL TRAYS TO BE USED ON THIS SYSTEM

REVISION	DATE	DESCRIPTION	BY

AEROWERKS
1150 Eighth Line Rd., Unit 16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

CUSTOMER:	PURCHASE ORDER NO:
JOB NAME: HARTFORD HOSPITAL	
TITLE: SOILED TRAY HANDLING SYSTEM	
DATE: OCTOBER 21, 2001	JOB NO: J017084
SCALE: 3/8" = 1'-0"	
DRAWN BY: K. ESTAFANOS	DRAWING NO: 01
CHECKED BY:	

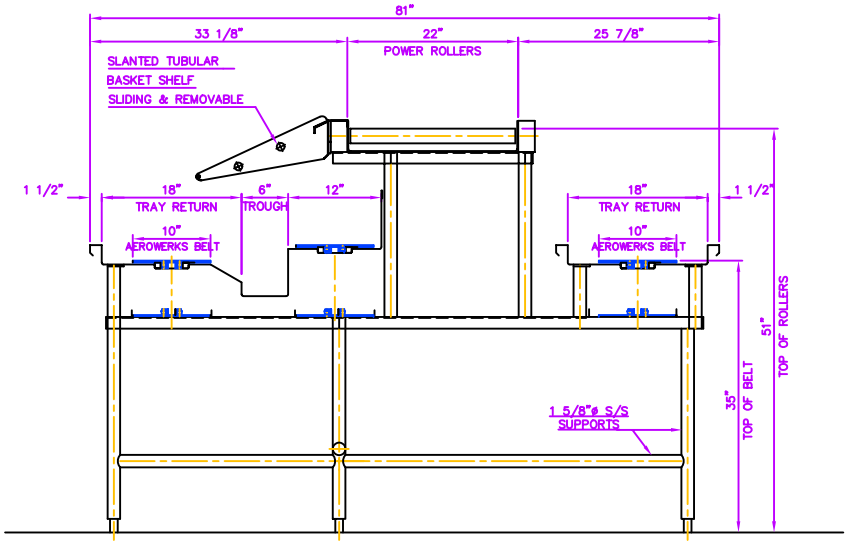

SECTION A 1|2

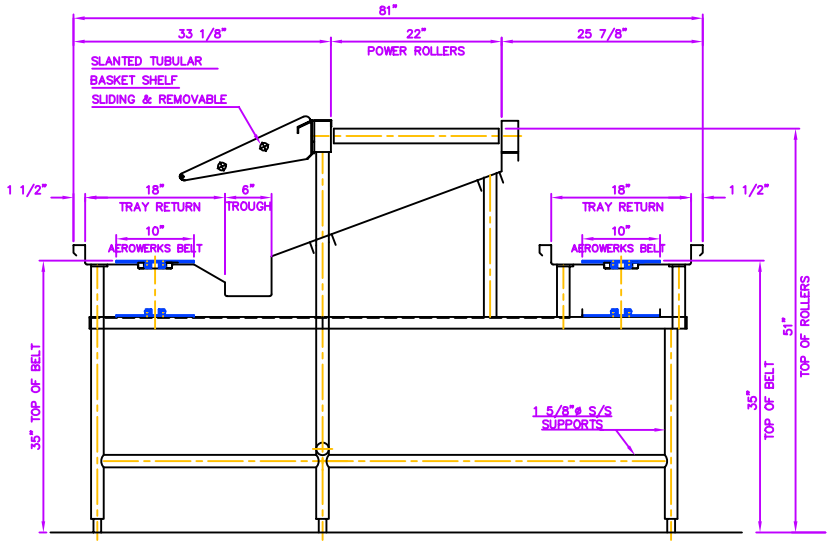

SECTION B 1|2

REVISION	DATE	DESCRIPTION	BY

AEROWERKS

1150 Eighth Line Road, Unit 16, Oakville, Ontario L6H2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

CUSTOMER:	PURCHASE ORDER NO:
JOB NAME: HARTFORD HOSPITAL	
TITLE: SOILED TRAY HANDLING SYSTEM CROSS SECTIONS	
DATE: OCTOBER 21, 2001	JOB NO: J017084
SCALE: 1 1/2" = 1'-0"	
DRAWN BY: K. ESTAFANOS	DRAWING NO: 02
CHECKED BY:	

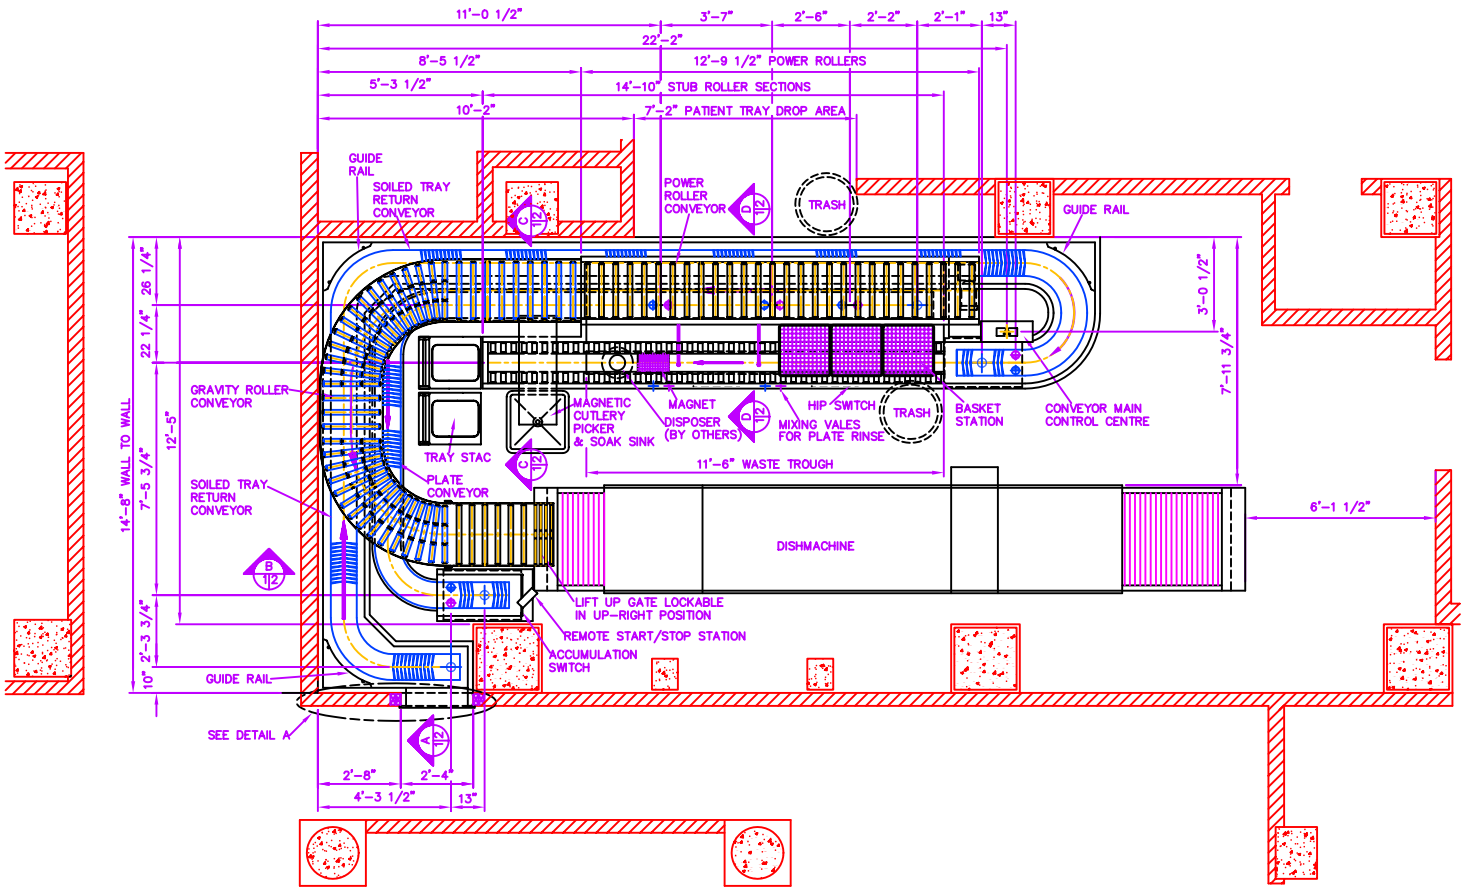

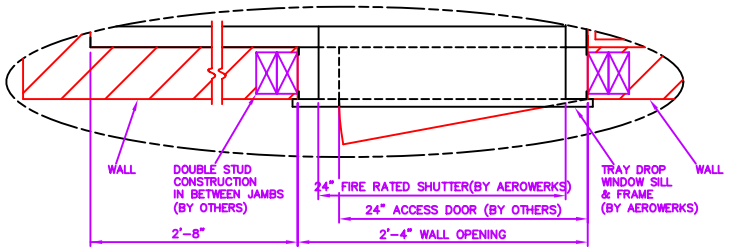

DETAIL A
NOT TO SCALE

LEGEND FOR FINAL MECHANICAL & ELECTRICAL CONNECTIONS

- 1/2"ø HOT & COLD WATER SUPPLY ~6" A.F.F.
- 1 1/2"ø DRAIN ~12" A.F.F.
- POWER SUPPLY 15A/480V/3ø/60Hz (FULL LOAD 8.0A) ~60" A.F.F.

NOTES:

1. ALL ROUGH-INS TO STUB UP & CAP OFF NO HIGHER THAN 4" A.F.F.
2. FINAL MECHANICAL CONNECTIONS TO DRAINS AND WATER SUPPLIES BY OTHERS.
3. FINAL ELECTRICAL CONNECTION TO MAIN CONTROL CENTRE BY OTHERS
4. FIELD WIRING OF CONVEYORS TO MAIN CONTROL CENTRE BY AEROWERKS @ TIME OF INSTALLATION
5. CUSTOMER TO PROVIDE SIZES OF ALL TRAYS TO BE USED ON THIS SYSTEM

REVISION	DATE	DESCRIPTION	BY
1	00/10/16	REVISED AS PER CUSTOMER'S NOTES	S.S

SCALE IN FT. 0 1 2 3 4 5

AEROWERKS
1150 Eighth Line, Unit 16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

CUSTOMER:	PURCHASE ORDER NO:
JOB NAME:	FRANSISCAN SKEMP HEALTHCARE
TITLE:	SOILED TRAY HANDLING SYSTEM PLAN VIEW
DATE:	JUNE 19, 2000
SCALE:	1/2" = 1'-0"
DRAWN BY:	SHEILA, SHI
CHECKED BY:	
JOB NO:	J006519
DRAWING NO:	01

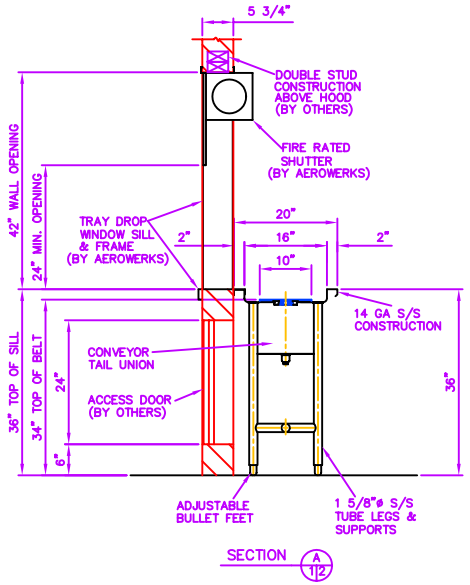

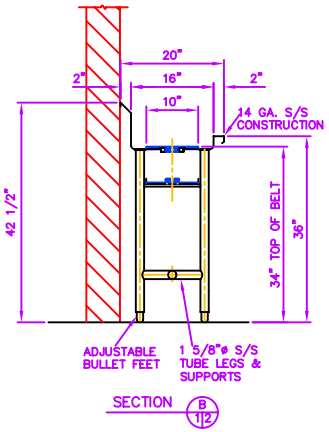

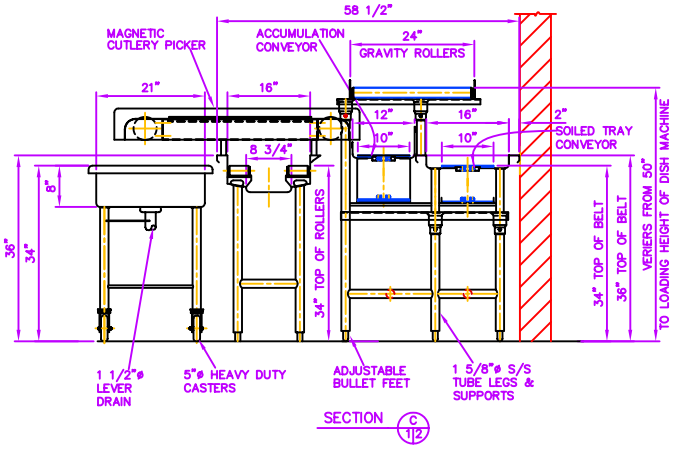

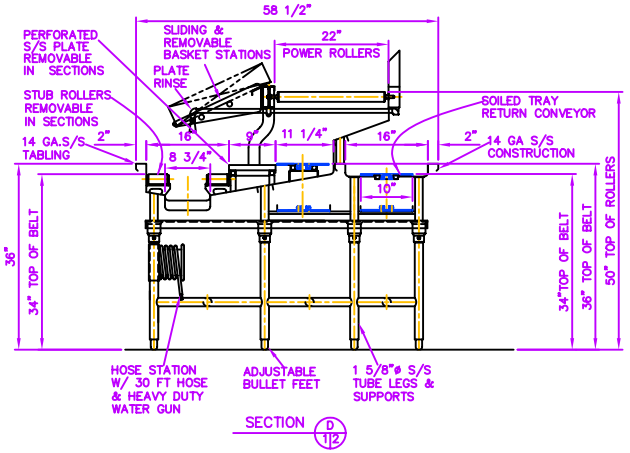

REVISION	DATE	DESCRIPTION	BY
1	00/10/16	REVISED AS PER CUSTOMER'S NOTES	S.S

0 1 2
SCALE IN FT.

AEROWERKS
1150 Eighth Line, Unit 16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

CUSTOMER:

JOB NAME: FRANSISCAN SKEMP HEALTH CARE

TITLE: SOILED TRAY HANDLING SYSTEM CROSS SECTIONS

DATE: JUNE 19, 2000

SCALE: 1" = 12"

DRAWN BY: SHEILA, SHI

CHECKED BY:

JOB NO: J006519

DRAWING NO: 02

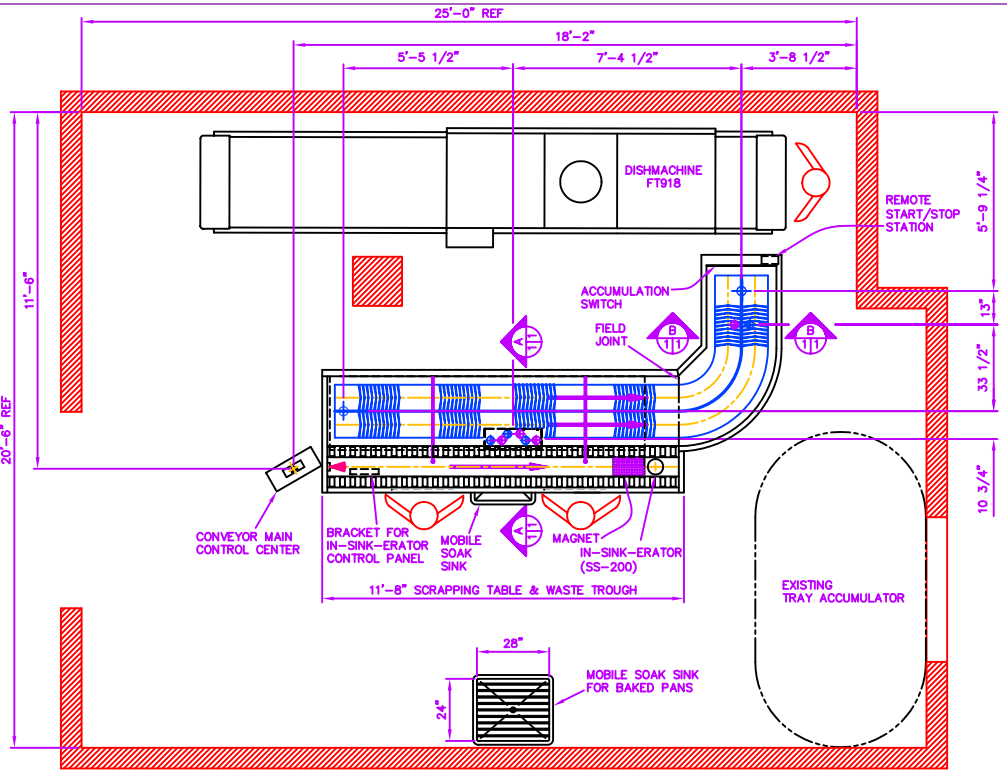

LEGEND FOR FINAL MECHANICAL & ELECTRICAL CONNECTIONS

- 1/2"ø HOT & COLD WATER SUPPLY ~6" A.F.F.
- 1 1/2"ø DRAIN ~12" A.F.F.
- POWER SUPPLY 15A/208V/1ø/60Hz (FULL LOAD 3.3A) ~60" A.F.F.

NOTES:

1. ALL ROUGH-INS TO STUB UP & CAP OFF NO HIGHER THAN 4" A.F.F.
2. FINAL MECHANICAL CONNECTIONS TO DRAINS AND WATER SUPPLIES BY OTHERS.
3. FINAL ELECTRICAL CONNECTION TO MAIN CONTROL CENTRE BY OTHERS
4. CUSTOMER TO PROVIDE SEPERATE 1/2" H&C WATER SUPPLY TO HOSE CLEAN UP STATION TO MAINTAIN PROPER WATER PRESSURE
5. FIELD WIRING OF CONVEYORS TO MAIN CONTROL CENTRE BY AEROWERKS @ TIME OF INSTALLATION
6. CUSTOMER TO PROVIDE SIZES OF ALL TRAYS TO BE USED ON THIS SYSTEM

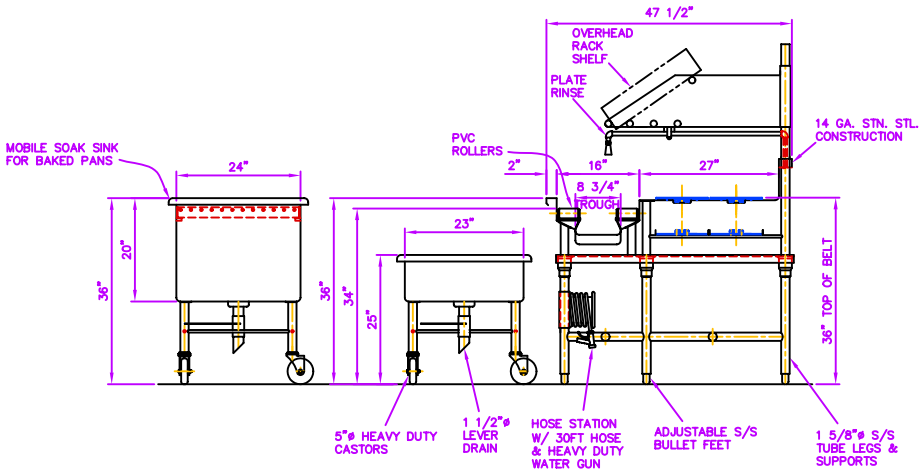

SECTION A/1.1
SCALE 1"=1'-0"

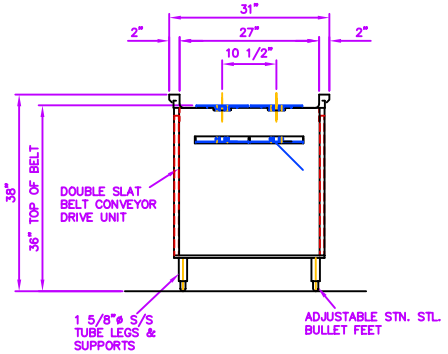

SECTION B/1.1
SCALE 1"=1'-0"

REVISION	DATE	DESCRIPTION	BY
2	NOV 07, 02	REVISED AS PER BUILT EQUIPMENT	AC
1	OCT 11, 02	GENERAL REVISION	AC

0 1 2 3 4 5
SCALE IN FT.

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

AEROWERKS
1150 Eighth Line, Unit #16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

CUSTOMER:	PURCHASE ORDER NO:
JOB NAME:	JOHN MUIR MEDICAL CENTER
TITLE:	SOILED TRAY HANDLING SYSTEM PLAN VIEW & CROSS SECTIONS
DATE:	JUNE 04, 2002
SCALE:	1/2" = 1'-0" & NOTED
DRAWN BY:	A. CHECHI
CHECKED BY:	
JOB NO:	J027344
DRAWING NO:	01

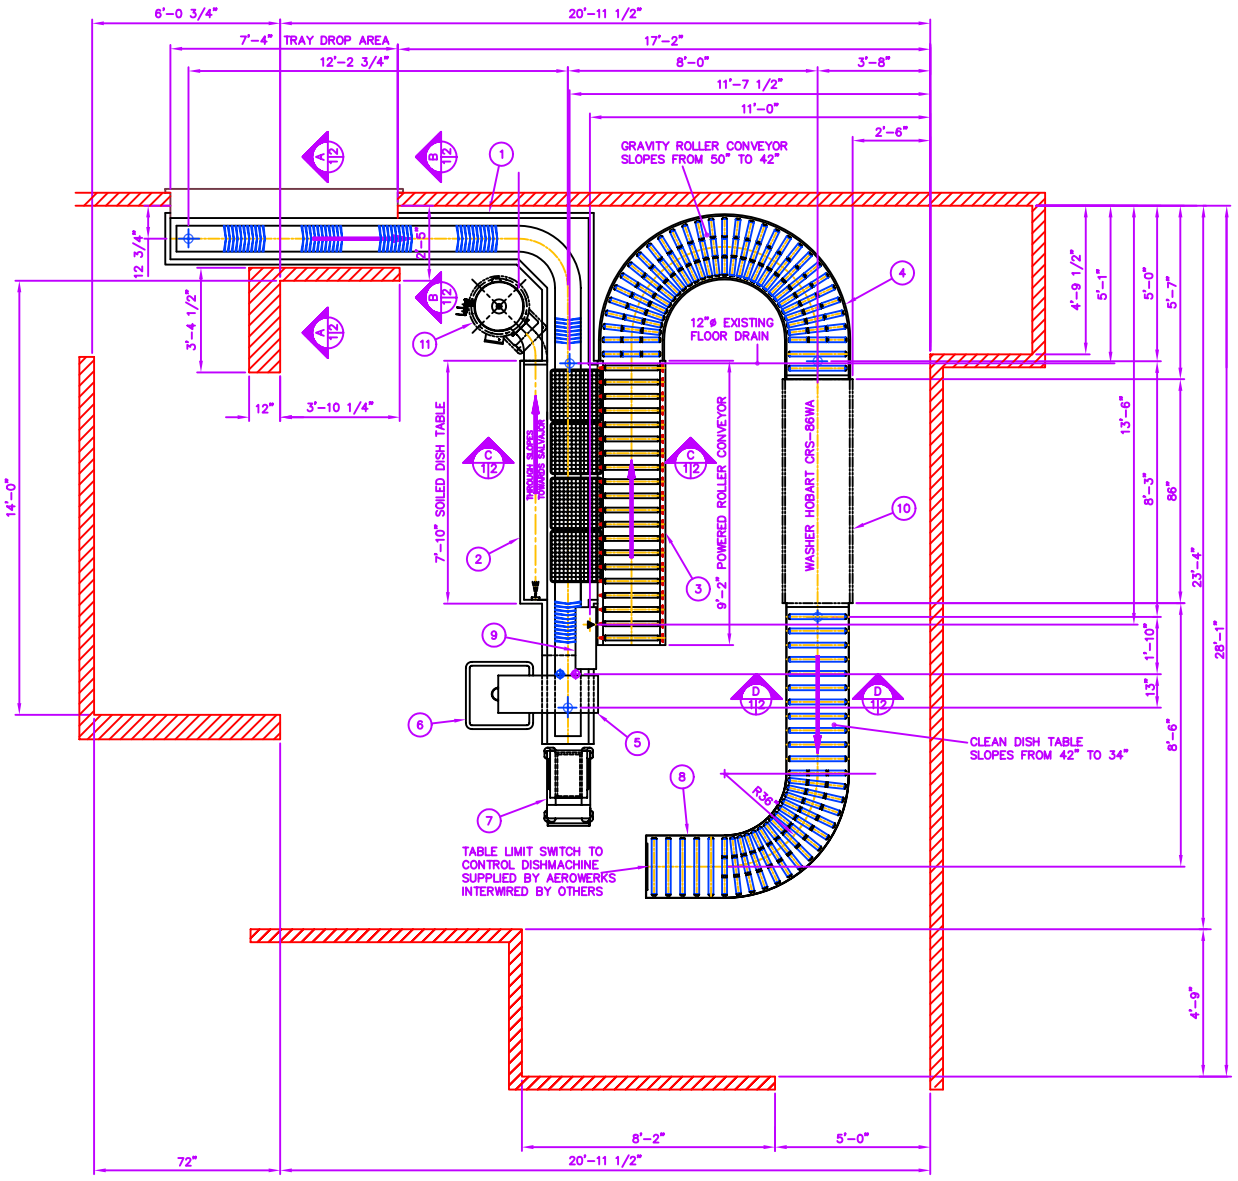

EQUIPMENT LIST

1. SOILED TRAY RETURN CONVEYOR
2. SOILED DISH TABLE
3. POWERED ROLLER CONVEYOR
4. GRAVITY ROLLER CONVEYOR
5. MAGNETIC CUTLERY PICKER
6. MOBILE SOAK SINK
7. TRAY LOWERATOR
8. CLEAN DISH ROLLER CONVEYOR TABLE
9. MAIN CONTROL CENTER
10. DISHWASHER (BY OTHERS)
11. SCRAP MASTER (BY OTHERS)

NOTES:

1. ALL ROUGH-INS TO STUB UP & CAP OFF NO HIGHER THAN 4" A.F.F.
2. FINAL MECHANICAL CONNECTIONS TO DRAINS AND WATER SUPPLIES BY OTHERS.
3. FINAL ELECTRICAL CONNECTION TO MAIN CONTROL CENTRE BY OTHERS
4. RECIRCULATING WATER LINE MOUNTED UNDER SOILED DISHTABLE TO TROUGH COLLECTOR BY OTHERS
5. FIELD WIRING OF CONVEYORS TO MAIN CONTROL CENTRE BY AEROWERKS @ TIME OF INSTALLATION
6. 14" X 18" & 15" X 20" TRAYS TO BE USED ON THIS SYSTEM

LEGEND FOR ROUGH-INS

- 1/2"ø HOT & COLD WATER SUPPLY ~6" A.F.F.
- 1 1/2"ø DRAIN ~12" A.F.F.
- POWER SUPPLY 15A/208V/3ø/60Hz (ACTUAL LOAD 6.43A) ~60" A.F.F.

REVISION	DATE	DESCRIPTION	BY
1	JUNE 22, 98	GENERAL REVISION	G.K.

SCALE IN FT. 0 1 2 3 4 5

AEROWERKS
1150 Eighth Line, Unit 16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

CUSTOMER:	HOLYOKE EQUIPMENT COMPANY, INC.
PURCHASE ORDER NO:	56075
JOB NAME:	ANA JACQUES HOSPITAL
TITLE:	SOILED TRAY HANDLING SYSTEM ITEMS 1 TO 9
DATE:	JUNE 3, 1998
JOB NO:	J985698
SCALE:	1/2" = 12"
DRAWN BY:	D. CHOUDHURY
DRAWING NO:	01
CHECKED BY:	

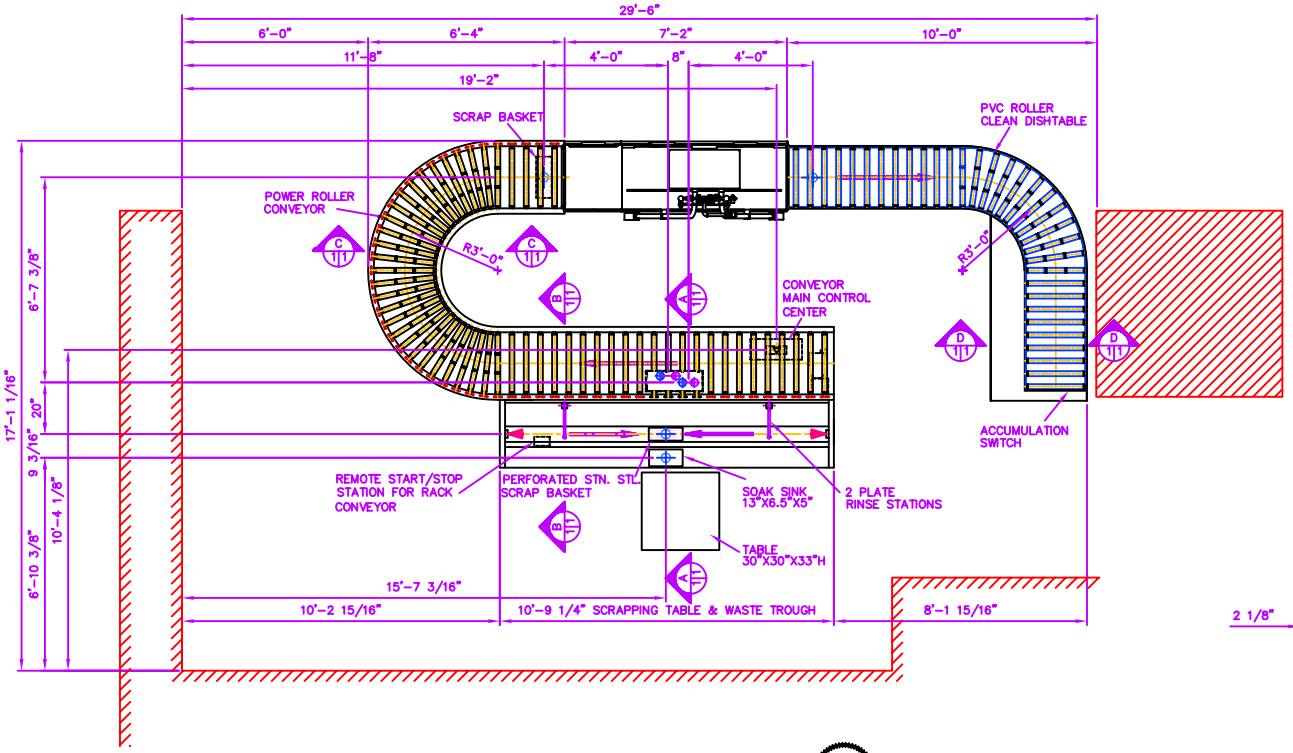

LEGEND FOR FINAL MECHANICAL & ELECTRICAL CONNECTIONS

- 1/2"ø HOT & COLD WATER SUPPLY ~6" A.F.F.
- 1 1/2"ø DRAIN ~12" A.F.F.
- POWER SUPPLY 15A/208V/1ø/60Hz (ACTUAL LOAD 1.4A) ~24" A.F.F.

NOTES:

1. ALL ROUGH-INS TO STUB UP & CAP OFF NO HIGHER THAN 4" A.F.F.
2. FINAL MECHANICAL CONNECTIONS TO DRAINS AND WATER SUPPLIES BY OTHERS.
3. FINAL ELECTRICAL CONNECTION TO MAIN CONTROL CENTRE BY OTHERS
4. FIELD WIRING OF CONVEYORS TO MAIN CONTROL CENTRE BY AEROWERKS @ TIME OF INSTALLATION
5. CUSTOMER TO PROVIDE SIZES OF ALL TRAYS TO BE USED ON THIS SYSTEM

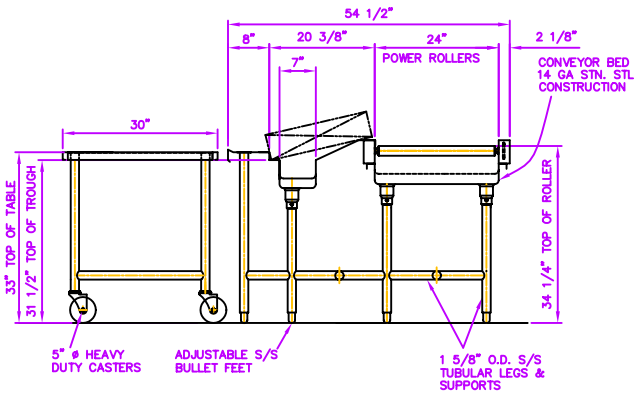

SECTION A 1/1
SCALE 1"=12"

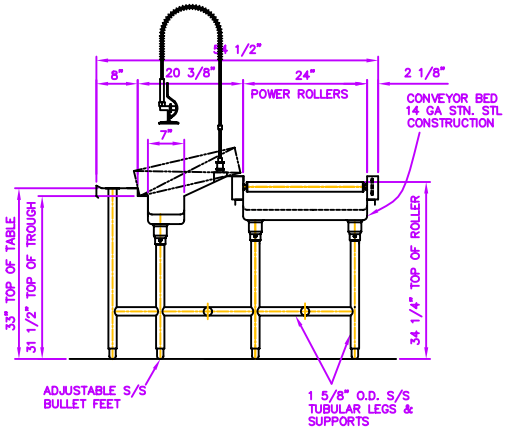

SECTION B 1/1
SCALE 1"=12"

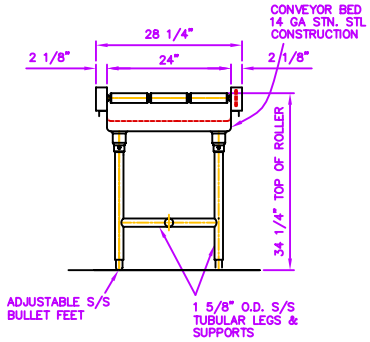

SECTION C 1/1
SCALE 1"=12"

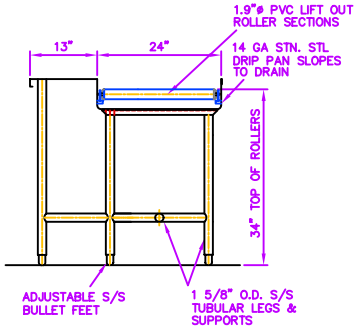

SECTION D 1/1
SCALE 1"=12"

REVISION	DATE	DESCRIPTION	BY
2	08/12/01	DISHMACHINE WAS L-R	Y.L
1	08/01/01	GENERAL REVISION	Y.L

0 1 2 3 4 5
SCALE IN FT.

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

AEROWERKS
1150 Eighth Line, Unit 16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

CUSTOMER:	PURCHASE ORDER NO:
JOB NAME:	ST. JOHN'S REHAB
TITLE:	SOILED TRAY HANDLING SYSTEM PLAN VIEW & CROSS SECTIONS
DATE:	MAY 22, 01
SCALE:	1/2" = 1'-0" & NOTED
DRAWN BY:	A. ESTAFANOS
CHECKED BY:	
JOB NO:	J016970
DRAWING NO:	01

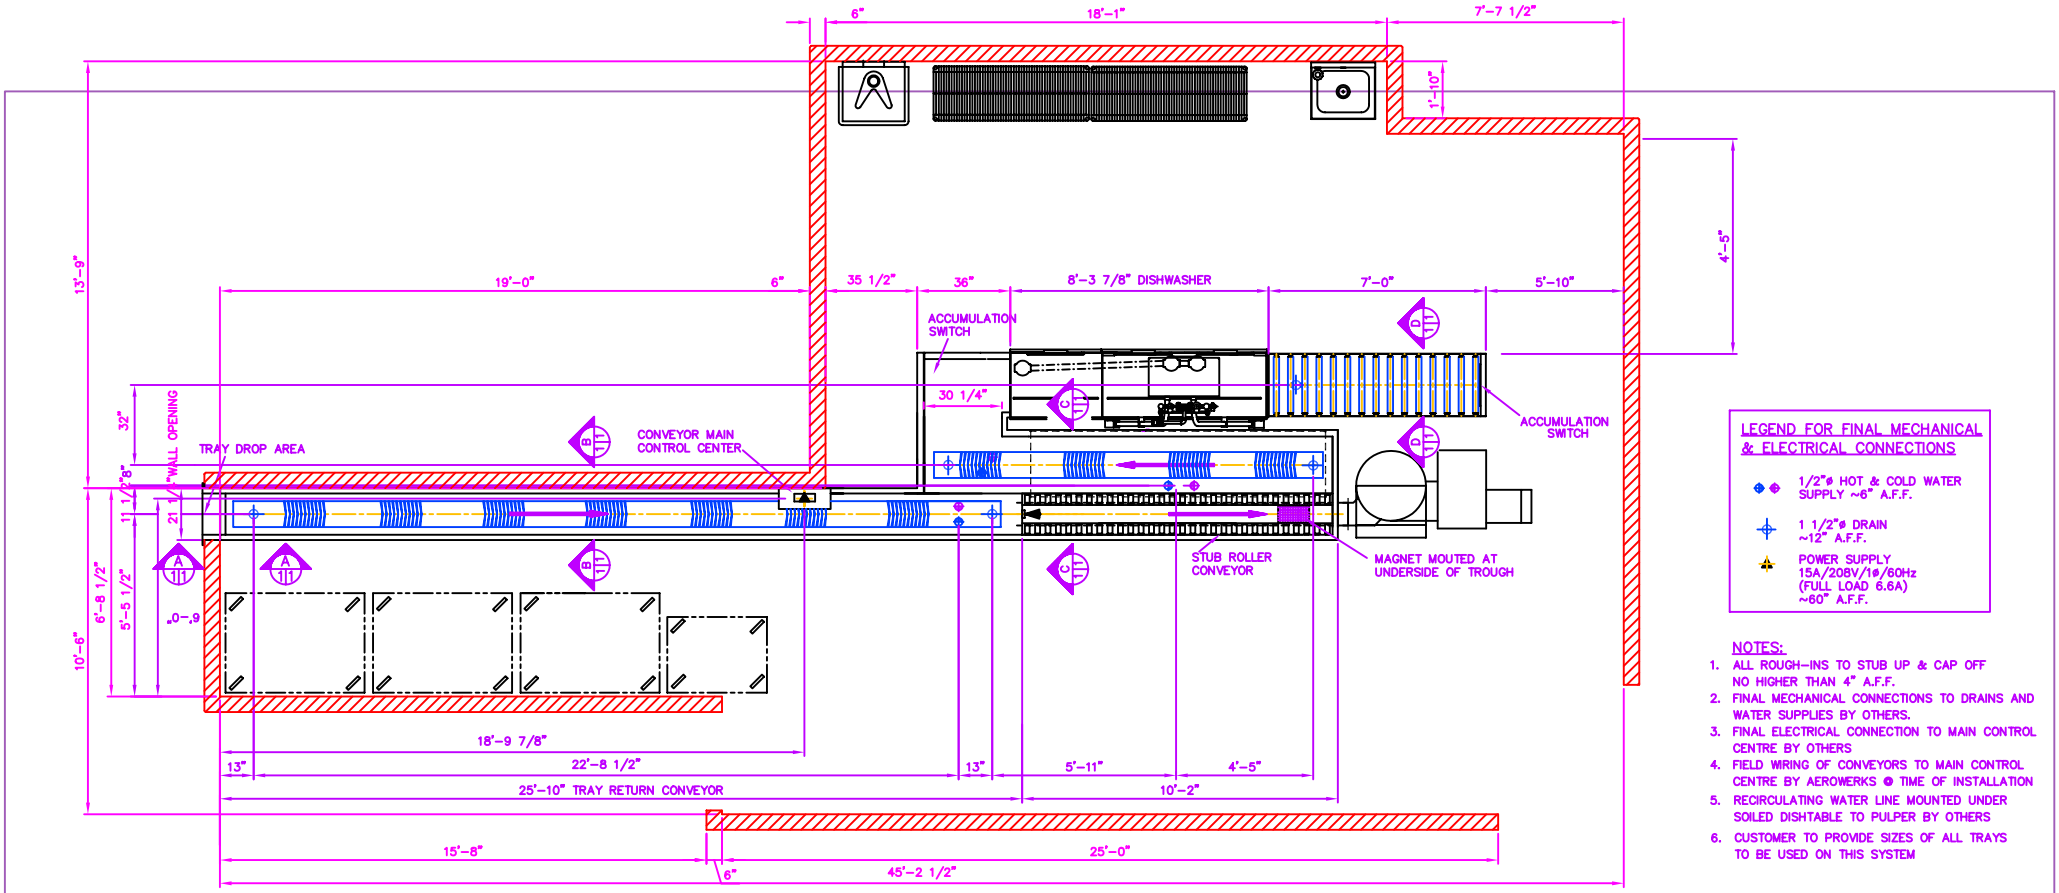

LEGEND FOR FINAL MECHANICAL & ELECTRICAL CONNECTIONS

- 1/2"ø HOT & COLD WATER SUPPLY ~6" A.F.F.
- 1 1/2"ø DRAIN ~12" A.F.F.
- POWER SUPPLY 15A/208V/1ø/60Hz (FULL LOAD 6.6A) ~60" A.F.F.

NOTES:

1. ALL ROUGH-INS TO STUB UP & CAP OFF NO HIGHER THAN 4" A.F.F.
2. FINAL MECHANICAL CONNECTIONS TO DRAINS AND WATER SUPPLIES BY OTHERS.
3. FINAL ELECTRICAL CONNECTION TO MAIN CONTROL CENTRE BY OTHERS
4. FIELD WIRING OF CONVEYORS TO MAIN CONTROL CENTRE BY AEROWERKS @ TIME OF INSTALLATION
5. RECIRCULATING WATER LINE MOUNTED UNDER SOILED DISHTABLE TO PULPER BY OTHERS
6. CUSTOMER TO PROVIDE SIZES OF ALL TRAYS TO BE USED ON THIS SYSTEM

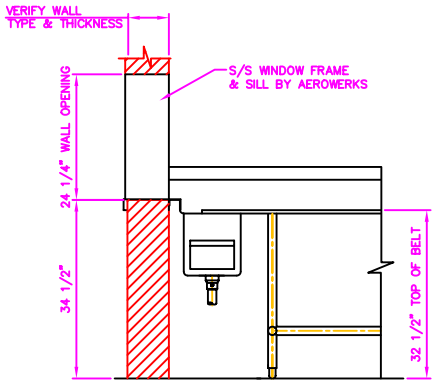

NOTE:
WALL OPENING DIMENSIONS MUST BE MAINTAINED TO COORDINATE WITH SOILED TRAY CONVEYOR

SECTION A 1/1
SCALE 1"=12"

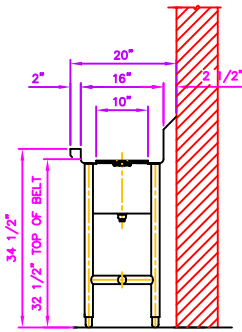

SECTION B 1/1
SCALE 1"=12"

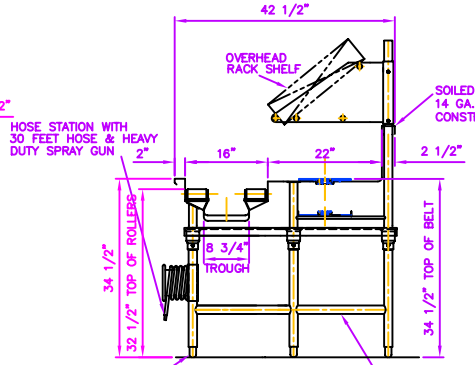

SECTION C 1/1
SCALE 1"=12"



SECTION D 1/1
SCALE 1"=12"

EQUIPMENT LIST

1 SOILED DISHTABLE/CONVEYOR/DISHTABLE

REVISION	DATE	DESCRIPTION	BY
1	02/28/01	GENERAL REVISIONS	L.Y.

0 1 2 3 4 5
SCALE IN FT.

AEROWERKS
1150 Eighth Line, Units 16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

CUSTOMER:	
JOB NAME:	USA CHILDREN'S & WOMEN'S CENTER
TITLE:	SOILED TRAY HANDLING SYSTEM PLAN VIEW & CROSS SECTION
DATE:	FEB. 21, 2001
SCALE:	1/2" = 1'-0" & NOTED
DRAWN BY:	YING LI
CHECKED BY:	
JOB NO:	J016774
DRAWING NO:	01REV

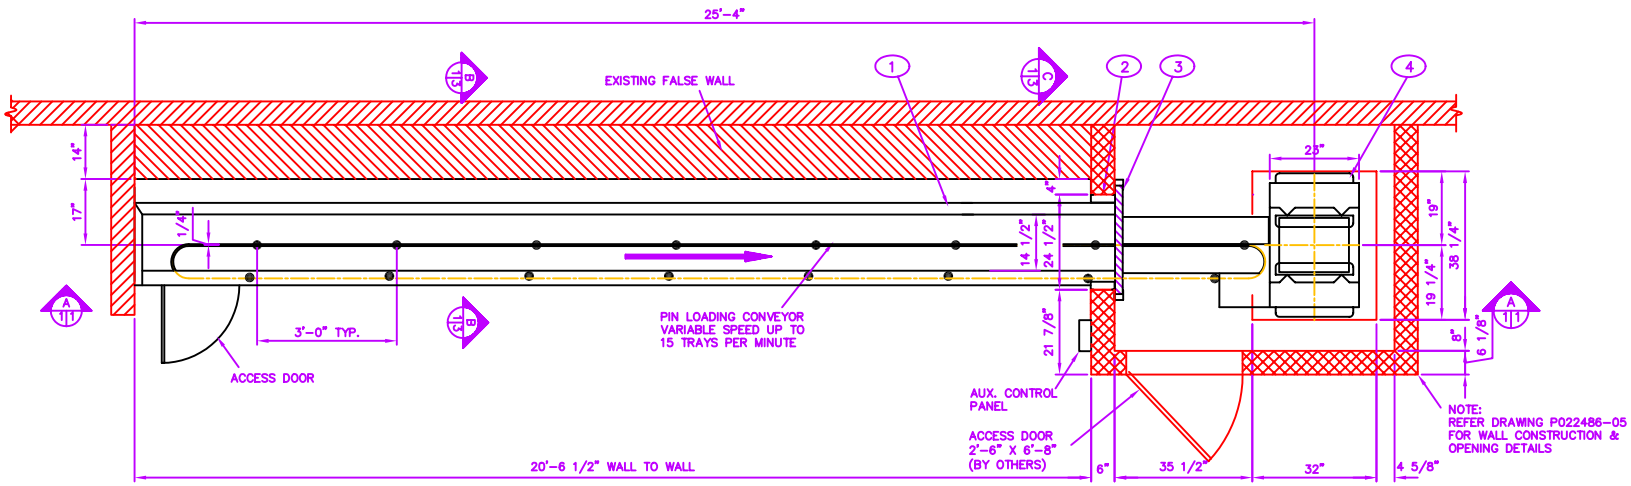

UPPER FLOOR

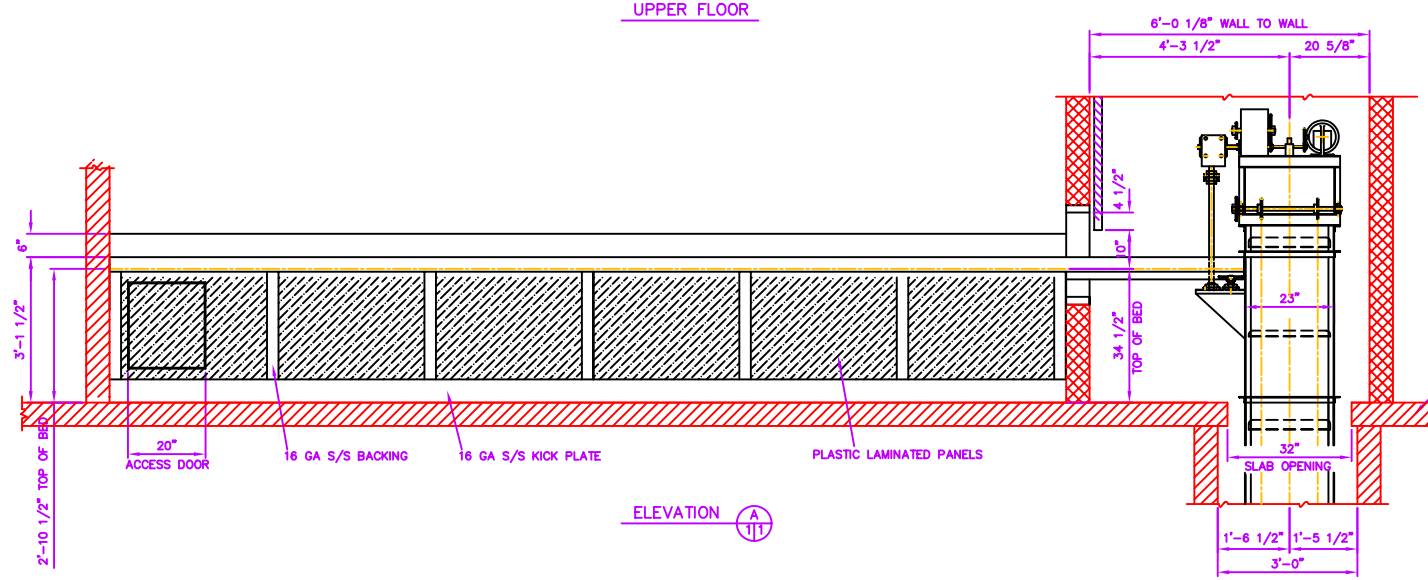

ELEVATION A 1|1

EQUIPMENT LIST BY AEROWERKS

ITEM	EQUIPMENT	QTY.	DRAWING NO.
1	TRAY RETURN PIN CONVEYOR	1	P022486-01
2	PASS THRU WINDOW FRAME & SILL	2	P022486-01&02
3	FIRE DOOR 1 1/2 HOUR RATED	2	P022486-01&02
4	VERTICAL TRAY CONVEYOR	1	P022486-01&02
5	POLYCORD TRAY UNLOAD CONVEYOR	1	P022486-02
6	SOILED DISH TABLE	1	P022486-02
7	TRAY STAC	2	P022486-02
8	CONVEYOR CONTROL SYSTEM	1	P022486-02
9	DISPOSER	1	P022486-02

REVISION	DATE	DESCRIPTION	BY
3	11/06/02	GENERAL REVISIONS	Y.L.
2	10/25/02	REVISED AS PER CUSTOMER'S VERIFIED	Y.L.
1	10/22/02	GENERAL REVISIONS	Y.L.

SCALE IN FT. 0 1 2 3

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

AEROWERKS
1150 Eighth Line, Unit 16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

CUSTOMER: PURCHASE ORDER NO:

JOB NAME: ST. JAMES HOSPITAL

TITLE: SOILED TRAY HANDLING SYSTEM
UPPER FLOOR PLAN VIEW & ELEVATION

DATE: OCT. 03, 2002
SCALE: 3/4" = 1'-0"
DRAWN BY: YING LI
CHECKED BY:

JOB NO: J027517
DRAWING NO: 01

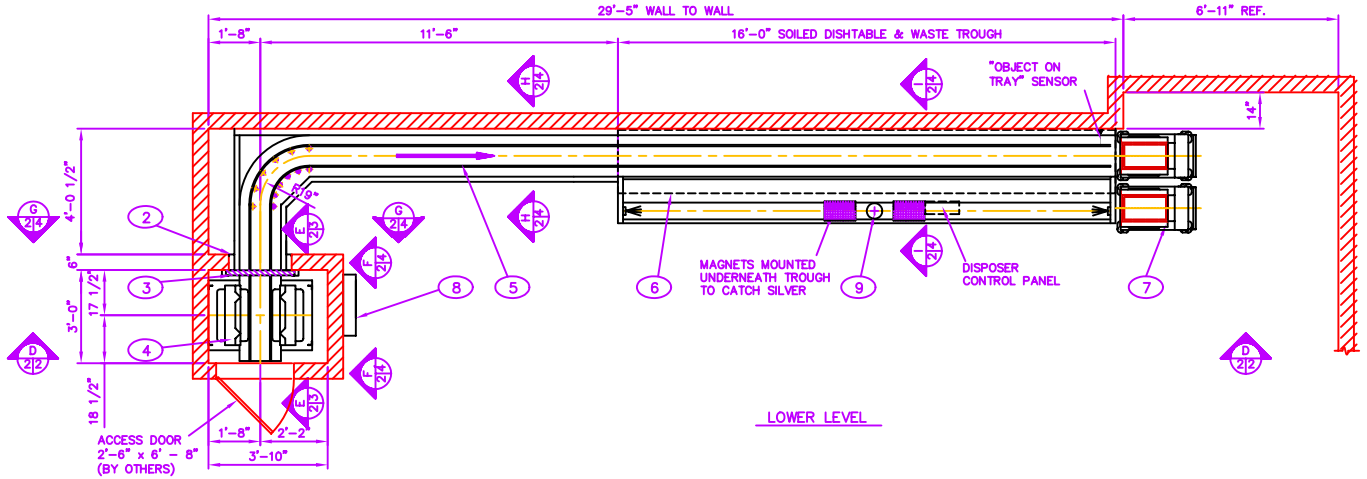

LOWER LEVEL

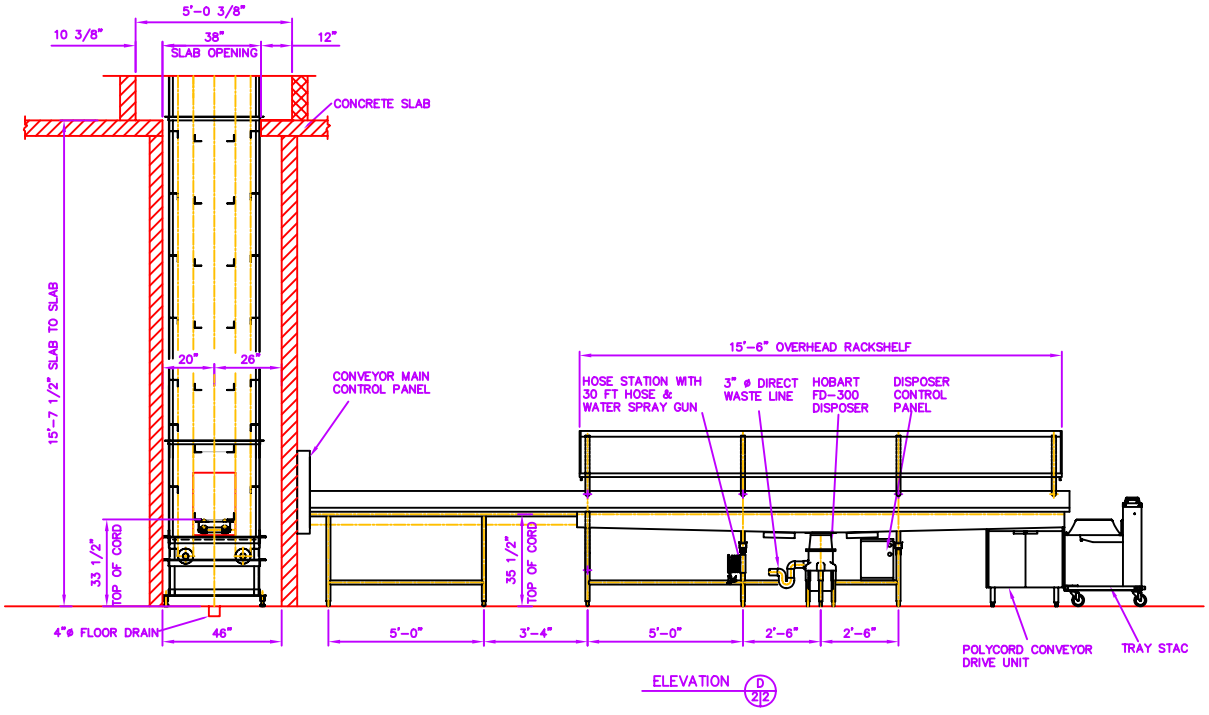

ELEVATION D 2/2

REVISION	DATE	DESCRIPTION	BY
1	10/16/02	GENERAL REVISIONS	Y.L

0 1 2 3 4 5
SCALE IN FT.

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

AEROWERKS
1150 Eighth Line, Unit 16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

CUSTOMER:	PURCHASE ORDER NO:
JOB NAME:	ST. JAMES HOSPITAL
TITLE:	SOILED TRAY HANDLING SYSTEM LOWER FLOOR PLAN VIEW & ELEVATION
DATE:	OCT. 03, 2002
SCALE:	1/2" = 1'-0"
DRAWN BY:	YING LI
CHECKED BY:	
JOB NO:	J027517
DRAWING NO:	02

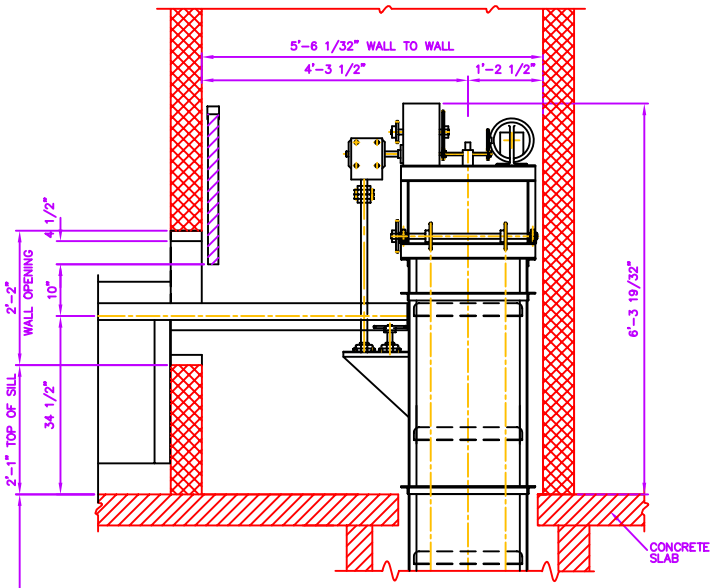

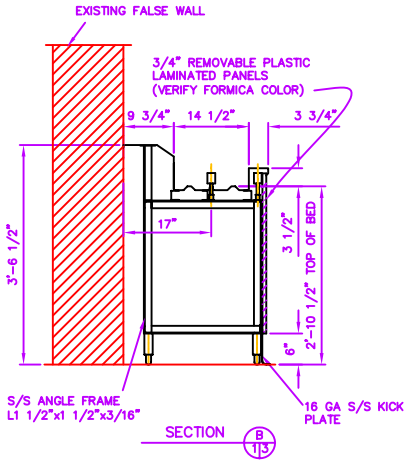

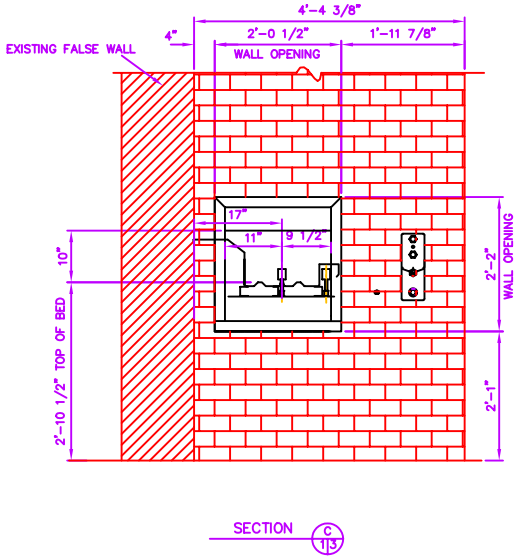

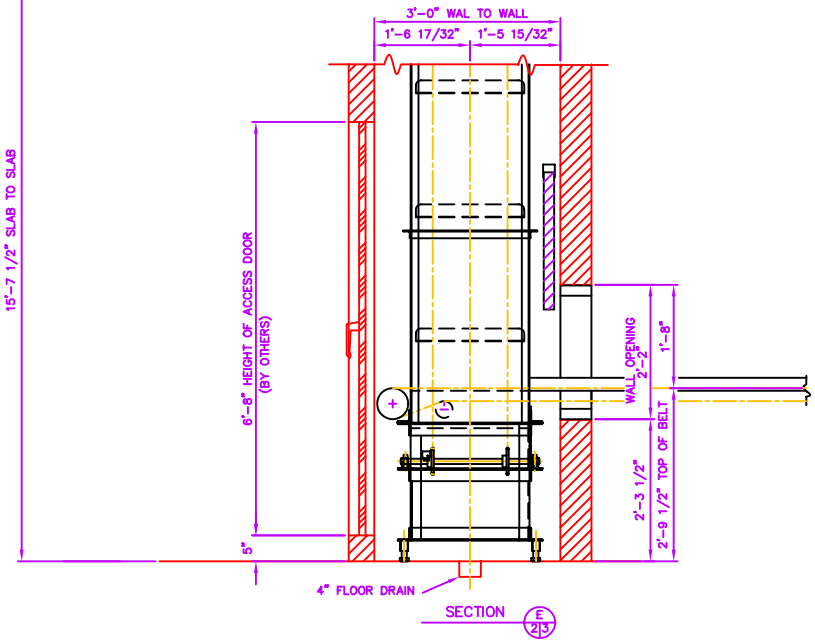

REVISION	DATE	DESCRIPTION	BY
3	11/06/02	GENERAL REVISIONS	Y.L.
2	10/22/02	GENERAL REVISIONS	Y.L.
1	10/16/02	GENERAL REVISIONS	Y.L.

0 1 2
SCALE IN FT.

AEROWERKS
1150 Eighth Line, Unit 16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

CUSTOMER:	PURCHASE ORDER NO:
JOB NAME:	ST. JAMES HOSPITAL
TITLE:	SOILED TRAY HANDLING SYSTEM CROSS SECTIONS
DATE:	OCT. 03, 2002
SCALE:	1" = 1'-0"
DRAWN BY:	YING LI
CHECKED BY:	
JOB NO:	J027517
DRAWING NO:	03

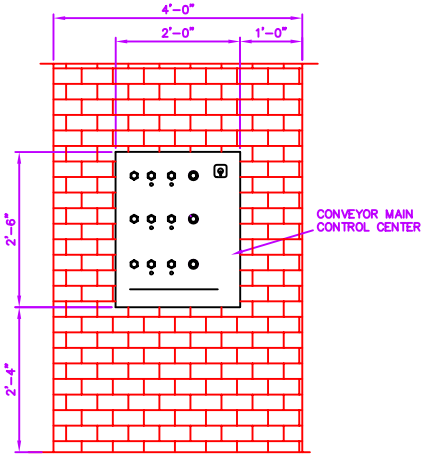

SECTION F 2/4

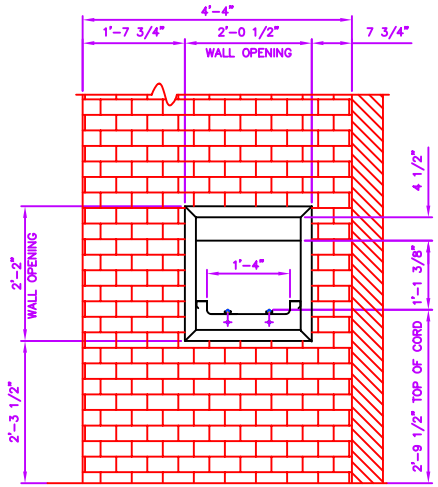

SECTION G 2/4

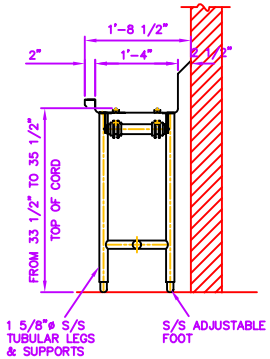

SECTION H 2/4

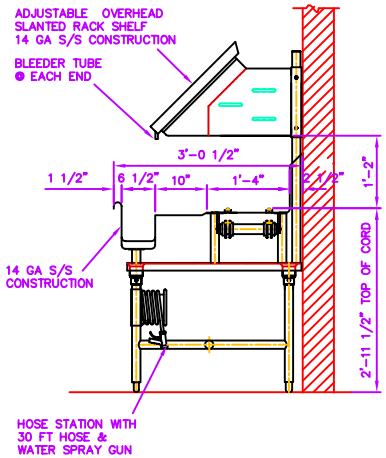

SECTION I 2/4

REVISION	DATE	DESCRIPTION	BY
2	11/06/02	GENERAL REVISIONS	Y.L
1	10/18/02	GENERAL REVISIONS	Y.L

0 1 2
SCALE IN FT.

AEROWERKS
1150 Eighth Line, Unit 16, Oakville, Ontario L6H 2R4
Tel: (905) 844-9449 Fax: (905) 844-0042

ALL IDEAS, DESIGNS, PLANS AND ARRANGEMENTS INDICATED BY THIS DRAWING ARE OWNED BY AND ARE THE PROPERTY OF AEROWERKS AND WERE CREATED AND DEVELOPED FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, PLANS OR ARRANGEMENTS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, CORPORATION OR FIRM FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF AEROWERKS.

CUSTOMER:	PURCHASE ORDER NO:
JOB NAME:	ST. JAMES HOSPITAL
TITLE:	SOILED TRAY HANDLING SYSTEM CROSS SECTIONS
DATE:	OCT. 03, 2002
SCALE:	1" = 1'-0"
DRAWN BY:	YING LI
CHECKED BY:	
JOB NO:	J027517
DRAWING NO:	04